

# TOWN OF FARMINGTON

1000 County Road #8  
Farmington, NY 14425  
(315) 986-8100

APPENDIX: **ST - 12.0**


DATE: 2023

SCALE: N.T.S.

**MRB** | group

**NOTES:**

- 1.) ALL LATERAL PIPING TO BE PVC SDR-35
- 2.) ALL TEE CONNECTIONS TO BE INSERTA TEE SEWER FITTING (REFER TO APPENDIX ST-13)
- 3.) CLEANOUTS SHALL BE PROVIDED AT A MAXIMUM DISTANCE OF 85' AND ONE SHALL ALSO BE LOCATED ON THE R.O.W. LINE. WHERE THE SEWER IS LOCATED OUTSIDE OF THE R.O.W. AND AN EASEMENT IS PROVIDED, PLACE CLEANOUT ON EASEMENT LINE (REFER TO APPENDIX G-7: TYPICAL SERVICE PLAN).
- 4.) EXTEND LATERAL 10' OR TO UTILITY EASEMENT (RG&E, CABLE, ETC.), WHICHEVER IS CLOSER

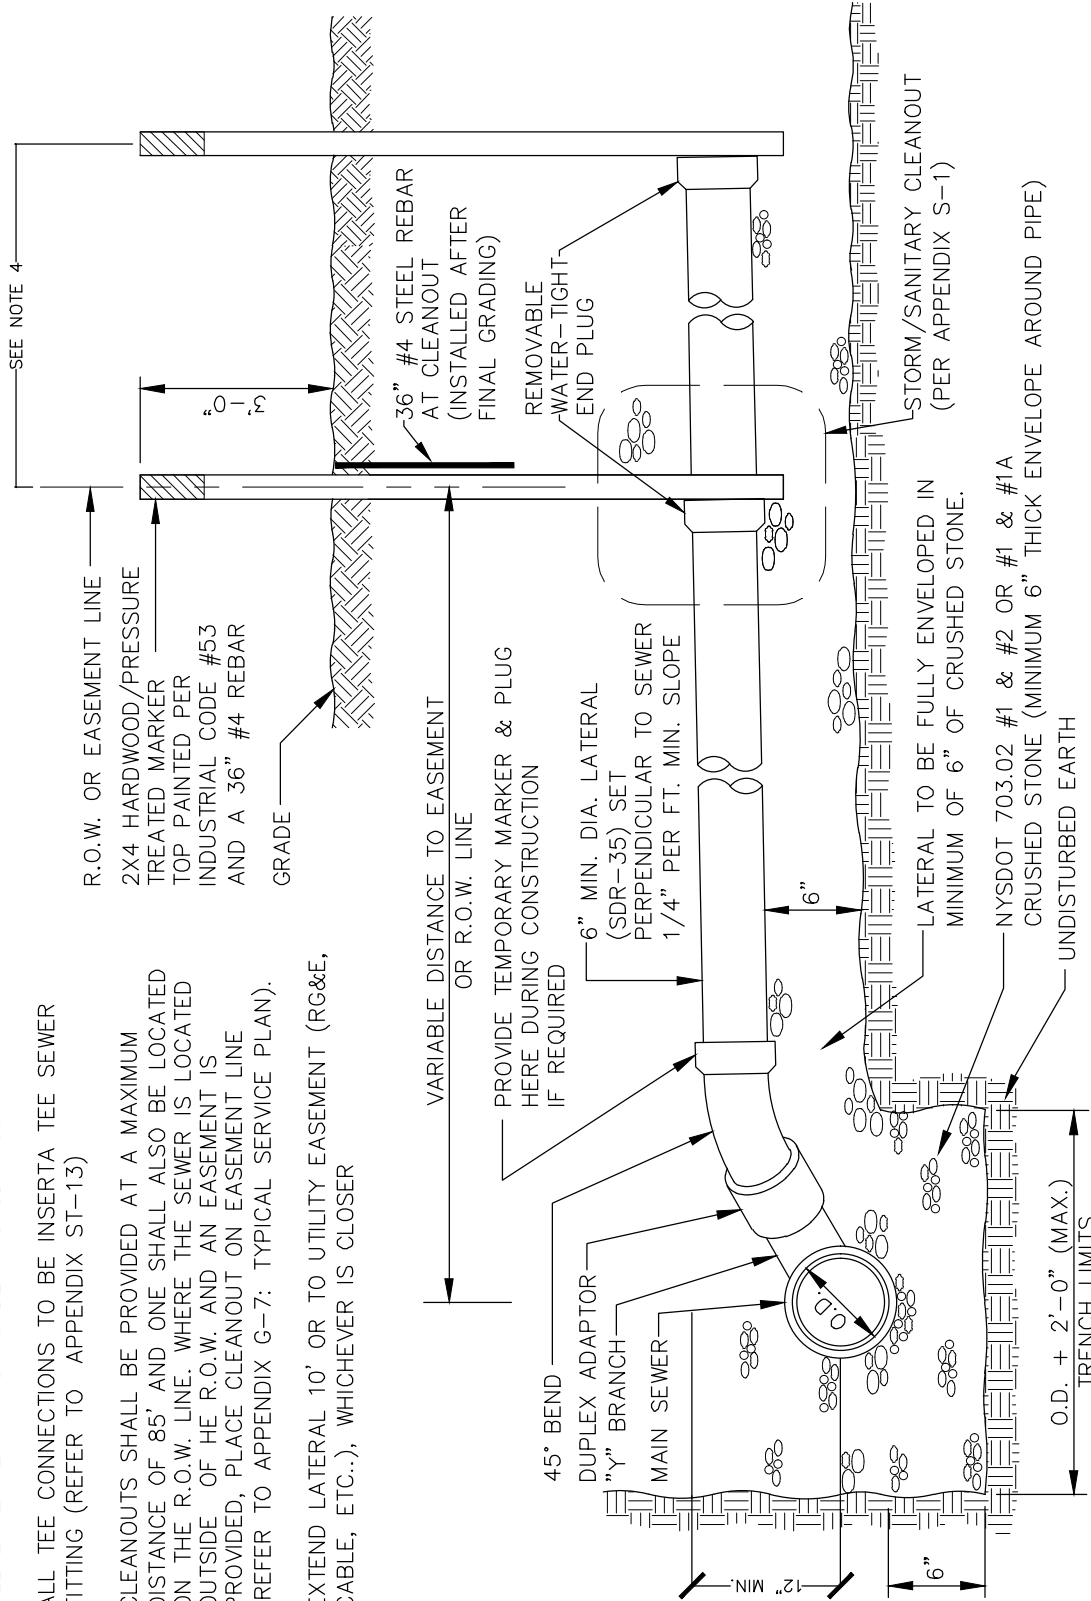

**STORM LATERAL DETAIL**